


CURB BOX TO BE BETWEEN CURB AND SIDEWALK UNLESS APPROVED OTHERWISE

MAXIMUM TAP SIZES	
MAIN SIZE	LARGEST TAP
6", 8"	1"
10"	1 1/2"
12"	2"

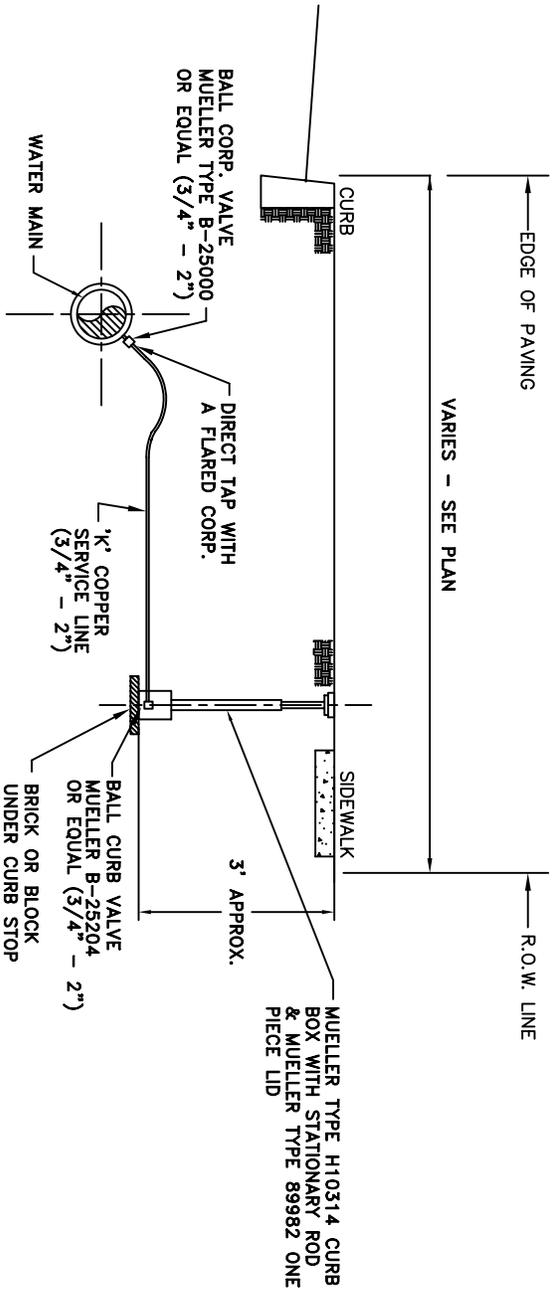

NOTE:

1. PVC PIPE ONLY PERMISSIBLE ON SERVICE SIDE OF CURB STOP BUT IN NO CASE SHALL THERE BE PVC PIPE IN THE ROADWAY
2. STAINLESS STEEL TAPPING SADDLES ONLY APPROVED FOR AGP OR PVC PIPE
3. CURB STOPS SHALL NOT BE LOCATED IN SIDEWALKS OR DRIVEWAYS.

BY	DATE	REVISIONS

**TOWNSHIP OF FLORENCE
WATER & SEWER DEPARTMENT**

**WATER MAIN
TYPICAL SERVICE**

DATE : **4/96**
DWN BY :